


VP	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48
Control panel	MODBUS RS485 connection	External control line	External stop	Fire system	OVR control	Common	Return water temp. sensor	NTC	Supply temp. sensor	NTC	Humidifier control	DX 0-10V control	Hot water mixing valve actuator	Cooling water pump 230VAC	Heating water pump 230VAC	Humidity sensor	Air quality sensor	Exhaust air pressure sensor	Supply air pressure sensor	Supply/exhaust air pressure sensor	Run	Alarm	Common	Heating	Cooling	Operation	Common	Water pump/coil alarm																				

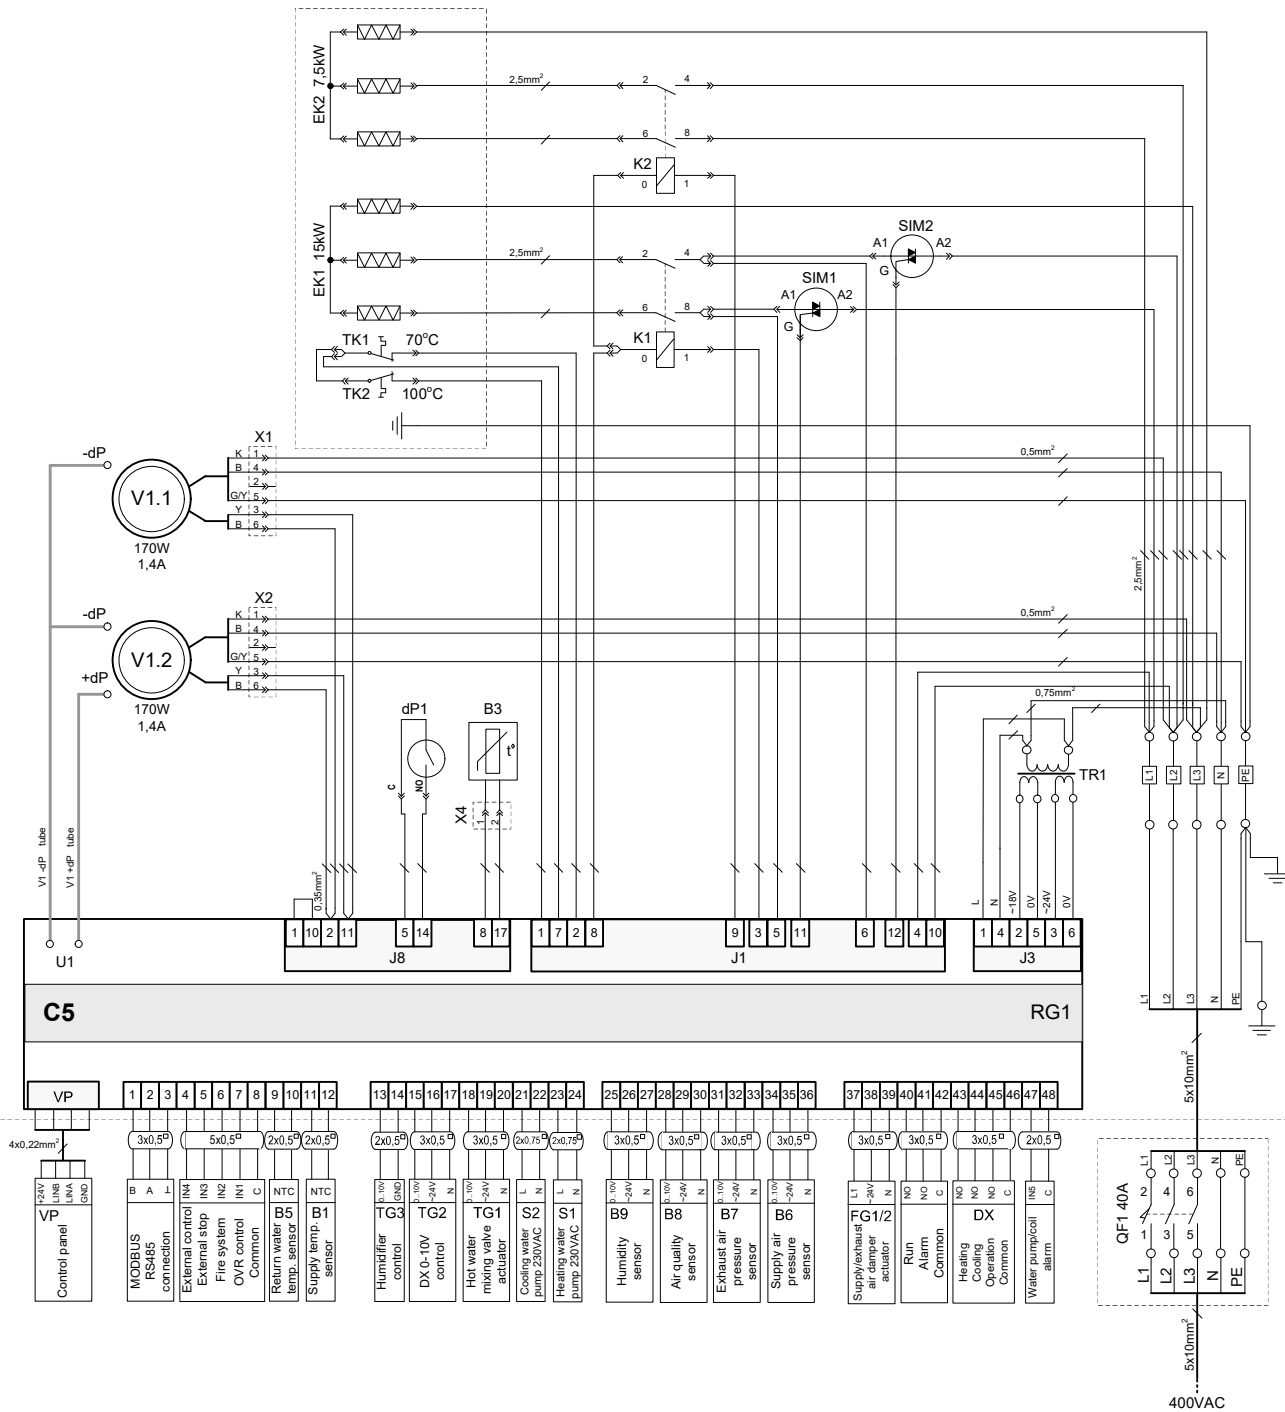

WD_S_2100_F_E22.5	
Date:	19.12.09
WIRING DIAGRAM	